


WATER VALVE VAULT

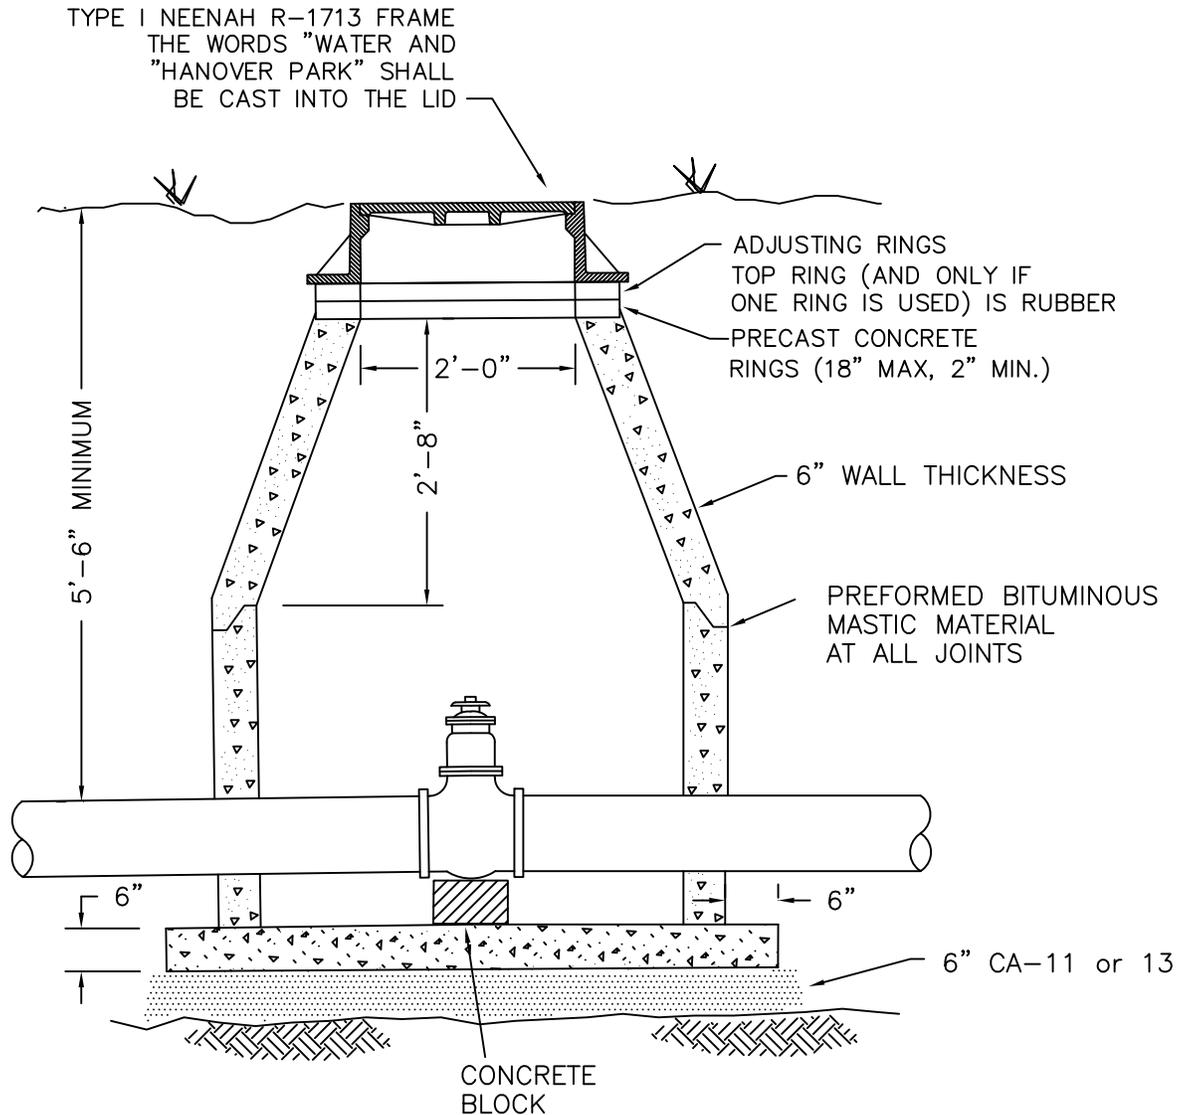

INSIDE DIAMETER SHALL BE 48" FOR WATER MAIN 6" THROUGH 10"
AND 60" FOR WATER MAIN 12" AND OVER

VALVES SHALL BE RESILIENT WEDGE GATE VALVES CONFORMING
TO AWWA C509 AND SHALL BE MUELLER OR CLOW

PRE-CAST REINFORCED CONCRETE RISER RINGS AND DOMES SHALL COMPLY WITH ASTM C-39.

ALL JOINTS BETWEEN PRE-CAST ELEMENTS, ADJUSTING RINGS AND MANHOLE
FRAMES SHALL BE SET IN PLACE WITH A BUTYL RUBBER JOINT SEALANT.

filename aci: Std Water Valve Vault

REVISIONS:

1. 2/14/2025



Hanover Park^{USA}

WATER VALVE VAULT
STANDARD DETAIL