

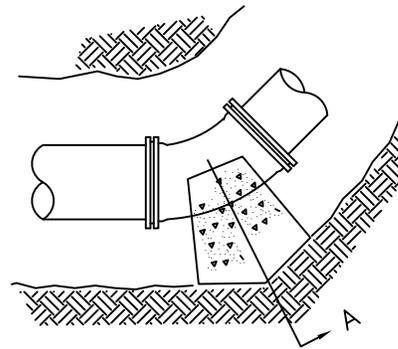
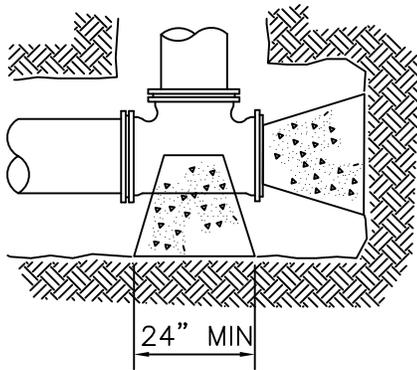
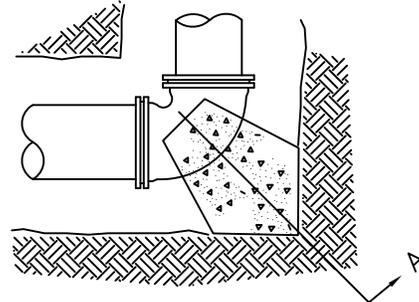


THRUST BLOCK INSTALLATION

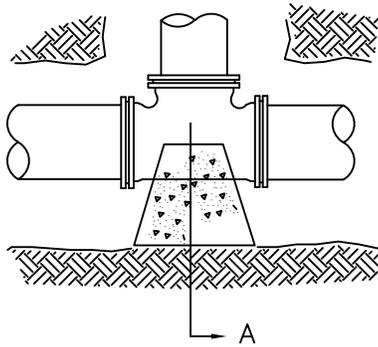

MINIMUM SQ. FT. AREA OF VERTICAL CROSS SECTION AGAINST 2000 PSF UNDISTURBED EARTH

	6"	8"	10"	12"
90° BEND	5.5	9.4	15.4	21.8
45° BEND	3.0	5.1	8.4	11.9
22.5° BEND	1.5	2.6	4.3	6.1
11.25° BEND	1.5	2.6	4.3	6.1
TEE	3.9	6.7	10.9	15.5

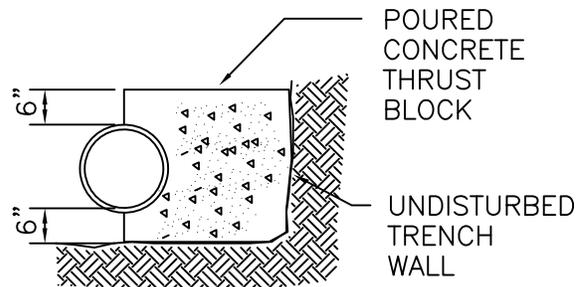

THRUST BLOCKING TO PREVENT MOVEMENT OF LINES UNDER PRESSURE AT BENDS, TEES, CAPS, VALVES, HYDRANTS AND AT POINTS SPECIFIED BY THE ENGINEER SHALL BE CLASS "SI" CONCRETE, A MINIMUM OF 12" THICK, PLACED BETWEEN SOLID GROUND AND FITTING, AND SHALL BE ANCHORED IN SUCH A MANNER THAT PIPE AND FITTING WILL BE ACCESSIBLE FOR REPAIRS. THRUST BLOCKS SHALL BE PLACED AT BENDS OF 11-1/4 DEGREES OR MORE. RETAINER GLANDS MAY BE USED IN PLACE OF THRUST BLOCKS. THE COST OF THRUST BLOCKS OR RETAINER GLANDS SHALL BE INCLUDED IN THE COST OF THE FITTING.

filename aci Std Water Thrust Block

REVISIONS:

1. 2/14/2025



Hanover Park ^{USA}

WATER THRUST BLOCK
STANDARD DETAIL