


WATER SERVICE DETAIL

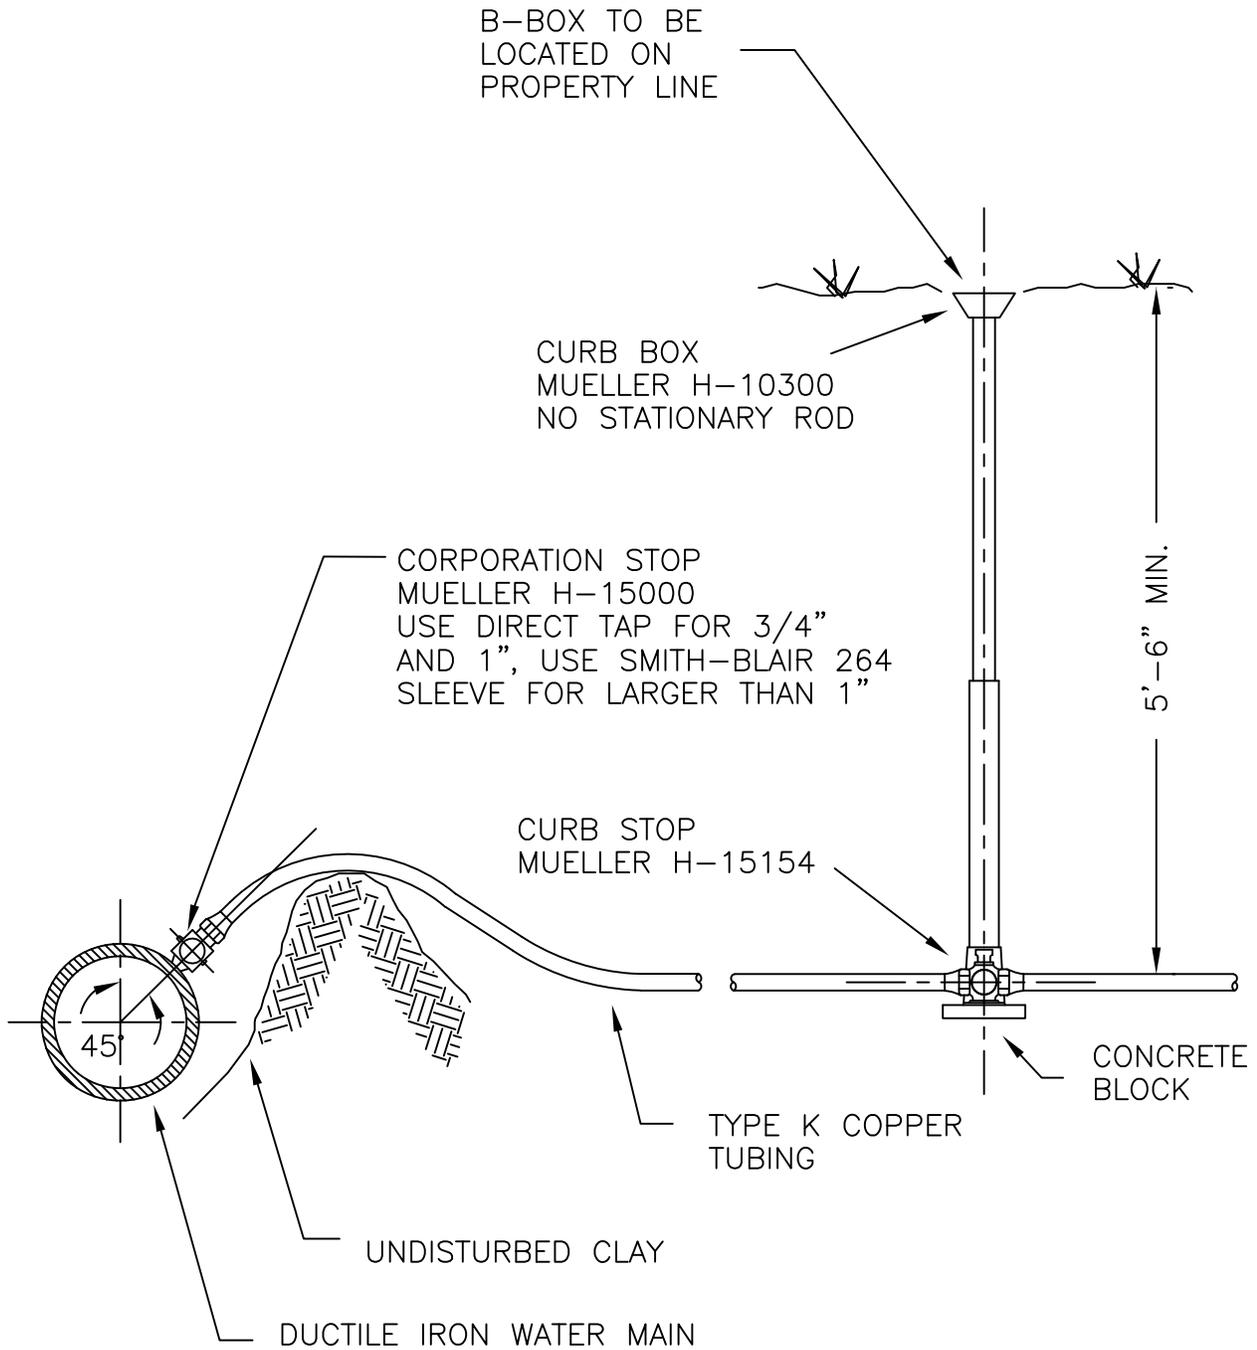

WATER SERVICE LINE SHALL BE IN A SEPARATE TRENCH 10 FT. FROM THE SANITARY SEWER SERVICE LINE OR IN THE SAME TRENCH BUT ON A SHELF 18" ABOVE THE SEWER LINE, IN WHICH CASE THE SEWER PIPE MATERIAL SHALL BE DUCTILE IRON OR SCHEDULE 40 PVC WITH SOLVENT WELD JOINTS.

filename ac: Std Water Service

REVISIONS:

1. 2/14/2025



Hanover Park^{USA}

WATER SERVICE
STANDARD DETAIL